

# VOLTAGE PORTALS

Provides maintenance personnel a no touch voltage verification on the outside of the cabinet

## VOLTAGE PORTAL FEATURES






- ▶ **Grace Voltage Portals** are PESDs that improves the task productivity by providing qualified maintenance worker a no-touch voltage verification on the outside of grounded metallic enclosures.
- ▶ **Voltage Portals** provide the means to perform the measured voltage test from outside the cabinet through the use of a Non-Contact Voltage Detector (NCVD) pen without the risk of being exposed to arc flash or shock hazards.
- ▶ Provides a safer and more productive method for performing LOTO, while enhancing compliance mandated by OSHA & NFPA 70E/CSA Z462.



## OPERATION

**Grace PESD® Voltage Portals** allow the task qualified maintenance worker to safely and productively perform the voltage verification from outside a grounded electrical enclosure. Installed on the door or flange of an electrical cabinet using a 1/2" or 30mm standard punch hole with a site specific procedure labels, workers' can perform the measured voltage test using an adequately rated CAT III/CAT IV Non-Contact Voltage detector (NCVD) pen during mechanical lockout/ tagout. The voltage portal is typically connected to the load side of the electrical disconnect by a qualified electrician.

## VOLTAGE PORTAL TECHNICAL SPECIFICATIONS

	CAT III	CAT IV	CAT III		
					
<b>COMPONENT CODE</b>	R-T3	R-3K	R-1A003-LPH*	R-1A003-LPF*	R-1A-LPA*
Voltage Type	AC				
Mounting Location	External (door mounted)				
Voltage to Door Required	Yes				
Lead Connections	3-Phase, 3-Wire	3 Phase, 3 wire Wires not supplied	Single Phase or 3 Phase, 3-Wire	Single Phase, 1-Wire	
Operational Temperature Range	-20°C to +60°C				
Operational Voltage Range	1000VAC				
Pollution Degree	2				
Wiring Specifications	PVC Insulated with Nylon Jacket, 6ft, 12 AWG, 90°C @ 1000 Volts, UL-1452	No additional wiring needed. Allows Wires sizes: 18 AWG to 12 AWG	PVC Insulated with Nylon Jacket, 6ft, 18 AWG, 90°C @ 1000 Volts, UL-1452		
Installation	30mm pushbutton hole		1/2" cutout		
Certifications	cUL Listed (#E334957) Type 4X, 12, 13, CE				

\*Labels sold in packages of 3.

**FOR MORE INFORMATION VISIT [PESD.COM](http://PESD.COM) OR CALL 1.800.280.9517**

**Warning:** Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.

© Grace Engineered Products, Inc. All rights reserved. Specifications are subject to change with/without notice.



## COMBINATION UNITS

**Combination units** take our voltage indicator and portal PEDS and couple them together with our custom labels. With a voltage indicator and portal connected to the same source, a task qualified worker can visually verify the voltage presence in addition to a measured test using a Non-Contact Voltage Detector pen. Combination Units are available to order with custom procedure labels and NCVD pens.



R-1A0033W-NPLPH



R-T3W2-LCH




R-T3W-LCF




R-1A0033W2-NPLPF

## LABELS

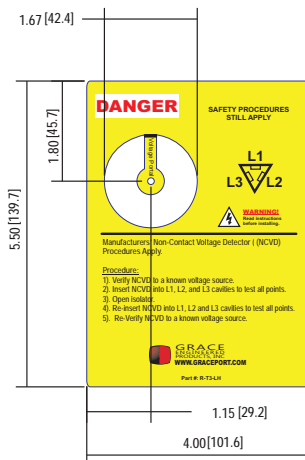

Horizontal Label  
Applies to the R-T3  
R-T3-LH

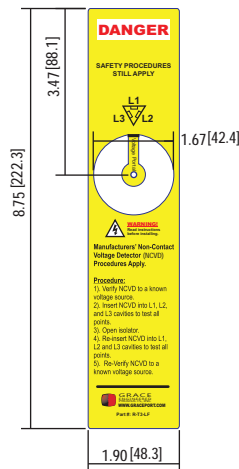

Vertical Label  
Applies to the R-T3  
R-T3-LF

## ACCESSORIES



Fluke® NCVD Pen

Custom label variations available upon request. Please call 1-800-280-9517 for more information.


FOR MORE INFORMATION VISIT [PESD.COM](http://PESD.COM) OR CALL 1.800.280.9517

**Warning:** Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.

© Grace Engineered Products, Inc. All rights reserved. Specifications are subject to change with/without notice.




## R-T3 DETAIL

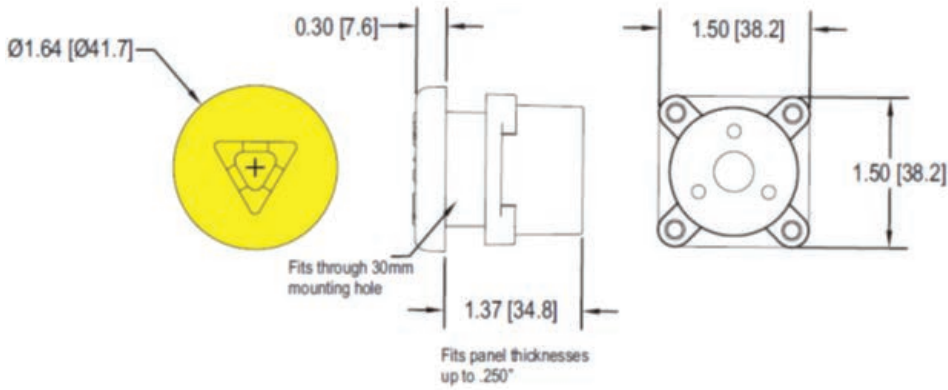

## R-T3 FEATURES

- ▶ 3 Phases combined into one unit
- ▶ Integral 6' #12 AWG lead wire
- ▶ Installs in a 30mm hole for easy installation
- ▶ Rugged polycarbonate construction for safety
- ▶ UV Outdoor rated so you can mount it in any grounded metallic enclosure
- ▶ Screws supplied with product

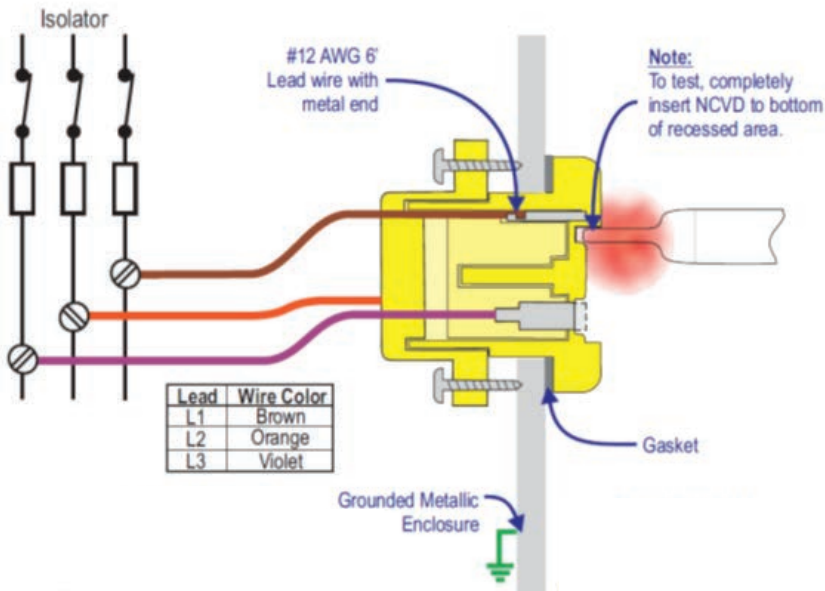

FOR MORE INFORMATION VISIT [PESD.COM](http://PESD.COM) OR CALL 1.800.280.9517

**Warning:** Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.


© Grace Engineered Products, Inc. All rights reserved. Specifications are subject to change with/without notice.








## R-3K DETAIL

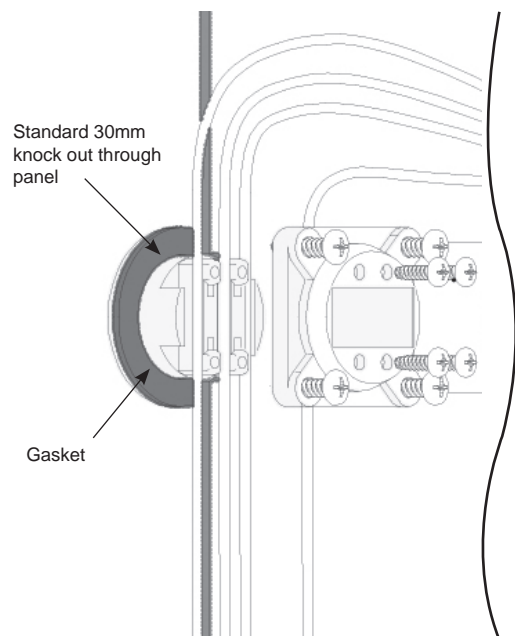


Self-tapping screws supplied with product.

## R-3K FEATURES

- ▶ Accepts wires from 18 - 12 AWG

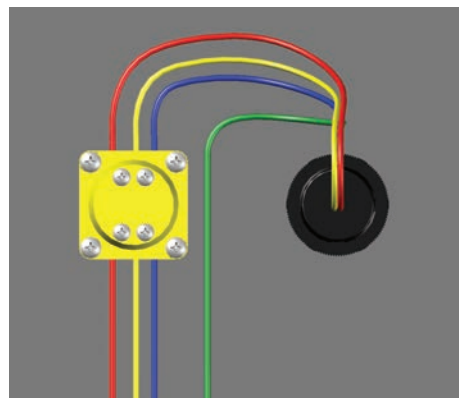

## R-3K WITH AN EXISTING VOLTAGE INDICATOR

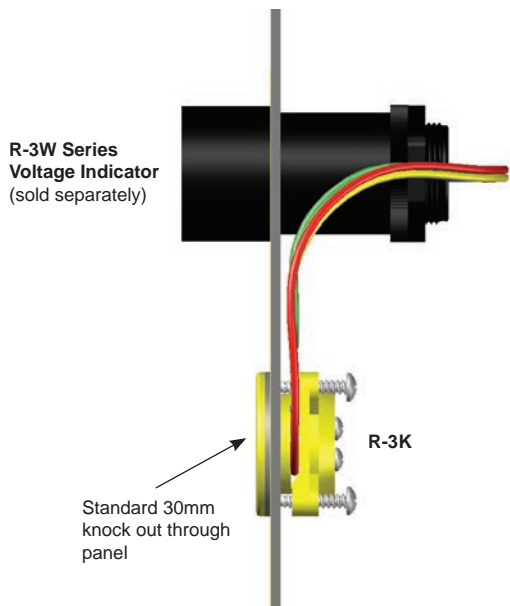

3 Phase leads combined into one unit (no need for additional wiring)

FOR MORE INFORMATION VISIT [PESD.COM](http://PESD.COM) OR CALL 1.800.280.9517


**Warning:** Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.

© Grace Engineered Products, Inc. All rights reserved. Specifications are subject to change with/without notice.




RoHS

## R-1A DETAIL

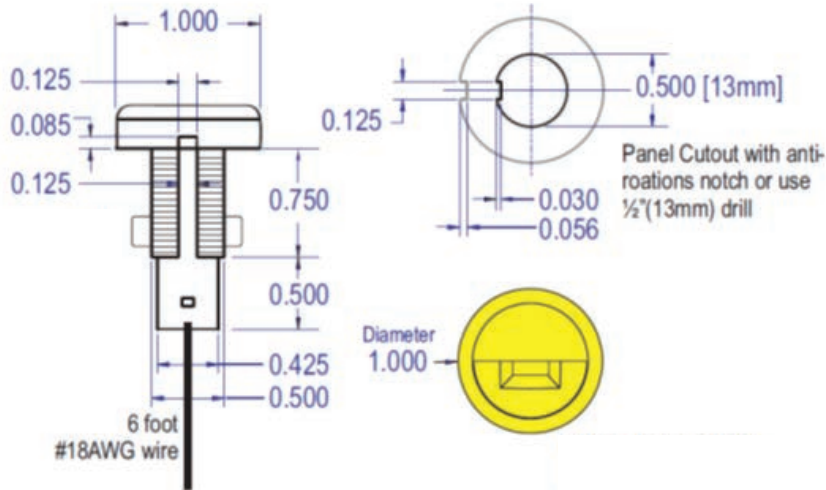

## R-1A FEATURES

- ▶ Integral 6' lead wire
- ▶ installs in a 1/2" hole for easy installation
- ▶ Rugged polycarbonate construction for safety
- ▶ UV Outdoor rated so you can mount on any grounded metallic enclosure

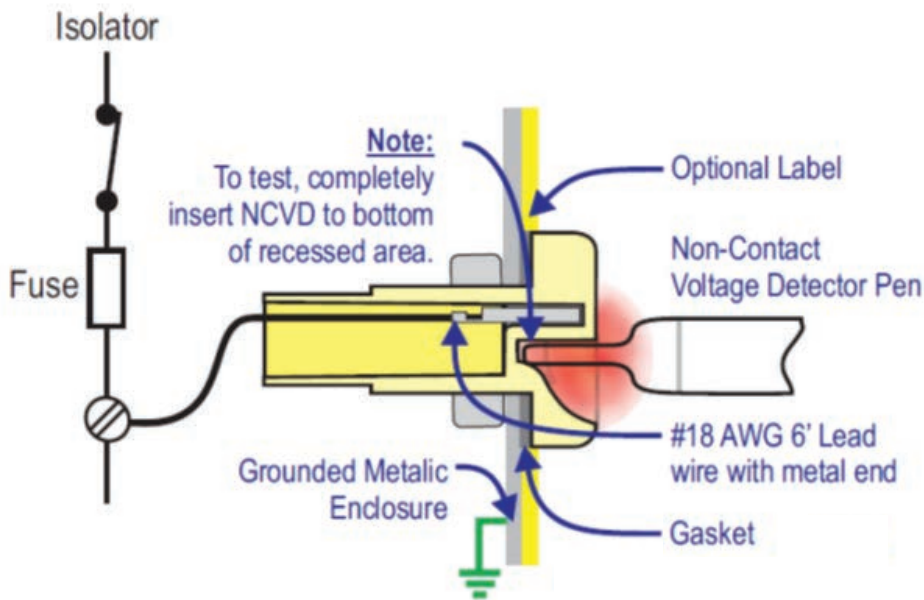

FOR MORE INFORMATION VISIT [PESD.COM](http://PESD.COM) OR CALL 1.800.280.9517

Warning: Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.

© Grace Engineered Products, Inc. All rights reserved. Specifications are subject to change with/without notice.

See the **Voltage Test Station Datasheet** for more information.

# SAFETY BY DESIGN

WITH THE **VOLTAGE TEST STATION**



## MINIMIZE RISK OF ARC FLASH & SHOCK HAZARD

The Voltage Test Station is a high impedance Permanent Electrical Safety Device (PESD) that allows qualified personnel to safely verify presence or absence of voltage from outside the enclosure. Through a closed-door metered test, routine tasks can be performed more efficiently and accurately with complete confidence in safety.

FOR MORE INFORMATION VISIT [PESD.COM](http://PESD.COM) OR CALL 1.800.280.9517



## FREQUENTLY ASKED QUESTIONS

**Q: How do Voltage Portal PESDs and NCVD pens assist during mechanical LOTO?**

*A: Once the Voltage Portal is properly installed, wired, and documented, a task qualified person can safely perform the measured test for presence of voltage using a NCVD pen from outside the electrical cabinet during mechanical LOTO.*

**Q: How do voltage portals enhance task productivity in mechanical LOTO?**

*A: Voltage Portals when used in conjunction with the Voltage Indicators and wired to the same source of voltage, enhances the productivity when a task qualified maintenance worker can quickly verify voltage presence using two redundant methods of visual indication and a NCVD pen at the LOTO point.*

**Q: Why should I use Voltage Portals ONLY on grounded metallic enclosures?**

*A: NCVD pens used with voltage portals rely on a capacitive coupling to ground, which makes the NCVD less versatile than a phase-to-phase/phase-to-ground voltmeter test. However, with Voltage Portals installed and the panel energized, workers can test the Voltage Portal with the NCVD to ensure it works. This means a capacitive ground connection exists and will always exist because panels do not move and workers stand in the same place when they test.*

**Q: Can I use voltage portals and NCVD pens on ungrounded systems?**

*A: No, ungrounded and isolated grounded systems may not always create a capacitive coupling to detect the voltage with NCVD pen.*

**Q: What is the advantage of installing a Voltage Portal in an electrical cabinet?**

*A: The ability to safely verify voltage presence for mechanical LOTO and pre-verify for electrical LOTO prior to opening an electrical panel using a SafeSide® Voltage Portal and NCVD pen puts an additional safety barrier between the worker and hazardous voltage.*

**Q: Can I use Voltage Portals and NCVD pens on DC voltage systems?**

*A: No, Voltage Portals and NCVD pens work only on AC voltage systems up to 1000 Volts. Voltage range and accuracy of the NCVD pen vary by manufacturer.*

**Q: Why should I use an adequately rated NCVD pen with voltage portals?**

*A: Most NCVD pens have a specific sensing range and ratings within which they are specified to operate properly. Some are designed to work on the lower voltage control circuit applications, others specified for residential and industrial environments. When selecting your NCVD pen, be sure to pick the one that meets your application environment and voltage ratings. Most industrial applications use 1000 Volts, CAT IV Rated NCVD pens.*

**Q: Can I use R-3K pass-thru Voltage Portals by themselves?**

*A: SafeSide® R-3K Voltage Portals are for use with new or existing R-3W series Voltage indicators. By passing the Voltage Indicator phase leads through the device, greatly saving installation time as there is no need for additional wiring and connections.*